


- B Water heater
- C After cooler
- F Electronic controller
- 1 Ball valve
- 2 Single check valve
- 4 Safety valve
- 9 Strainer
- 10 Circulator pump
- 11 Domestic hot water pump
- 16 Outdoor sensor
- 18 Thermometer
- 19 Surface sensor
- 22 Test connection
- 25 Manometer with ball valve
- 27 Actuator
- 30 Flow control w. control valve
- 36 Balancing valve
- 43 Ball valve closed
- 44 Immersion sensor

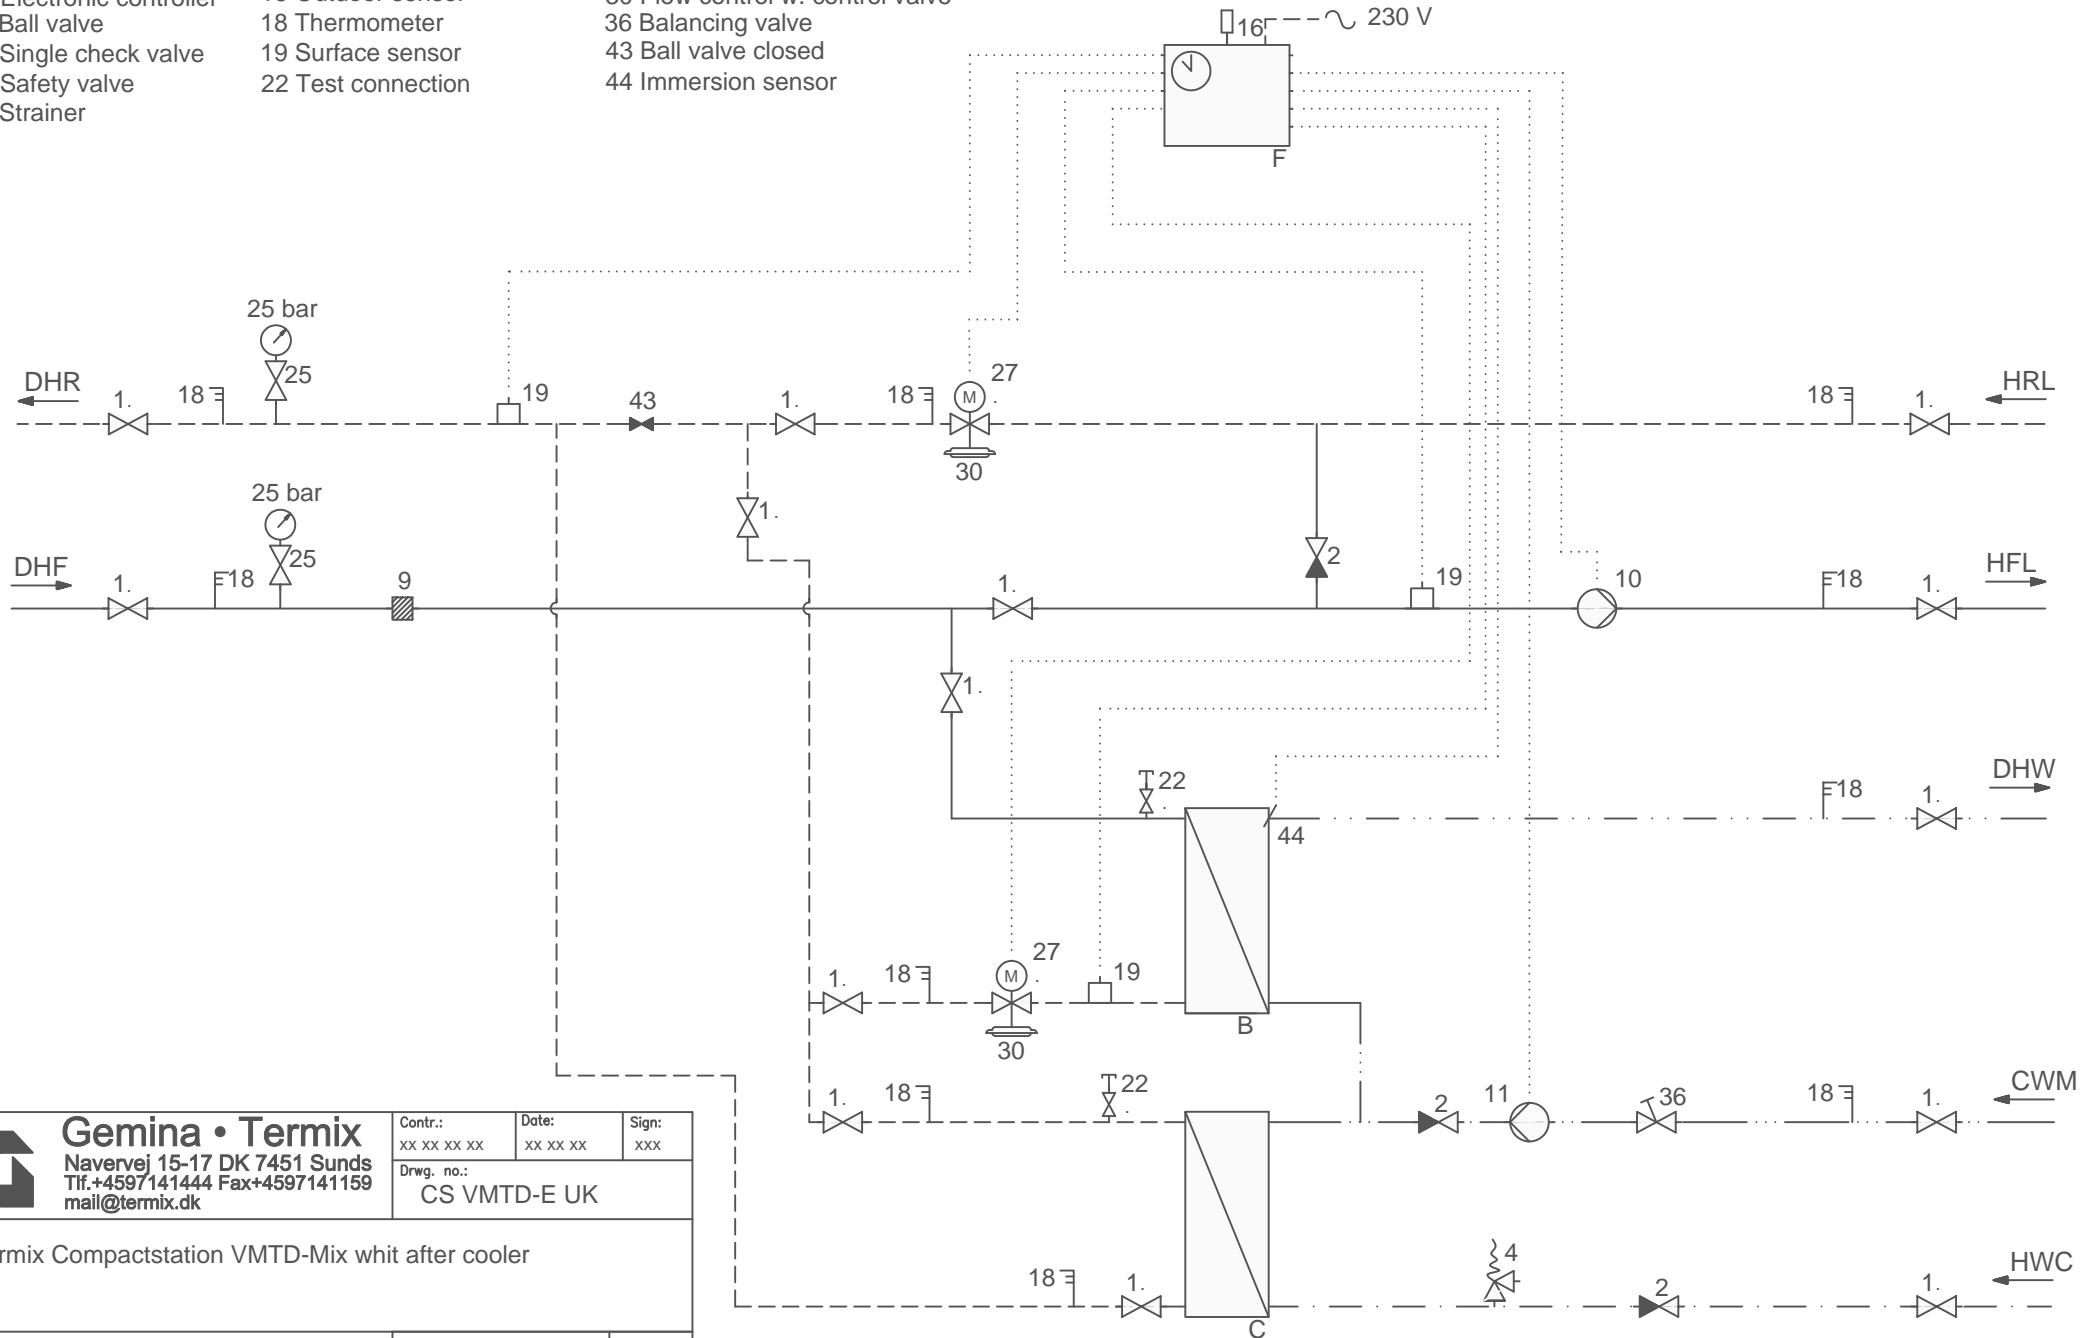

Gemina • Termix
 Navervej 15-17 DK 7451 Sunds
 Tlf.+4597141444 Fax+4597141159
 mail@termix.dk

Contr.: xx xx xx xx	Date: xx xx xx	Sign: xxx
Drwg. no.: CS VMTD-E UK		

Title:
Termix Compactstation VMTD-Mix whit after cooler

Diagram		
District Heating substation		
Rev:	Date:	Sign.: