


- B Water heater
- C After cooler
- F Electronic controller
- 1 Ball valve
- 2 Single check valve
- 4 Safety valve
- 9 Strainer
- 10 Circulator pump
- 11 Domestic hot water pump
- 12 Shunt pump
- 16 Outdoor sensor
- 18 Thermometer
- 19 Surface sensor
- 22 Test connection
- 25 Manometer with ball valve
- 27 Actuator
- 30 Flow control w. control valve
- 36 Balancing valve
- 43 Ball valve closed
- 44 Immersion sensor

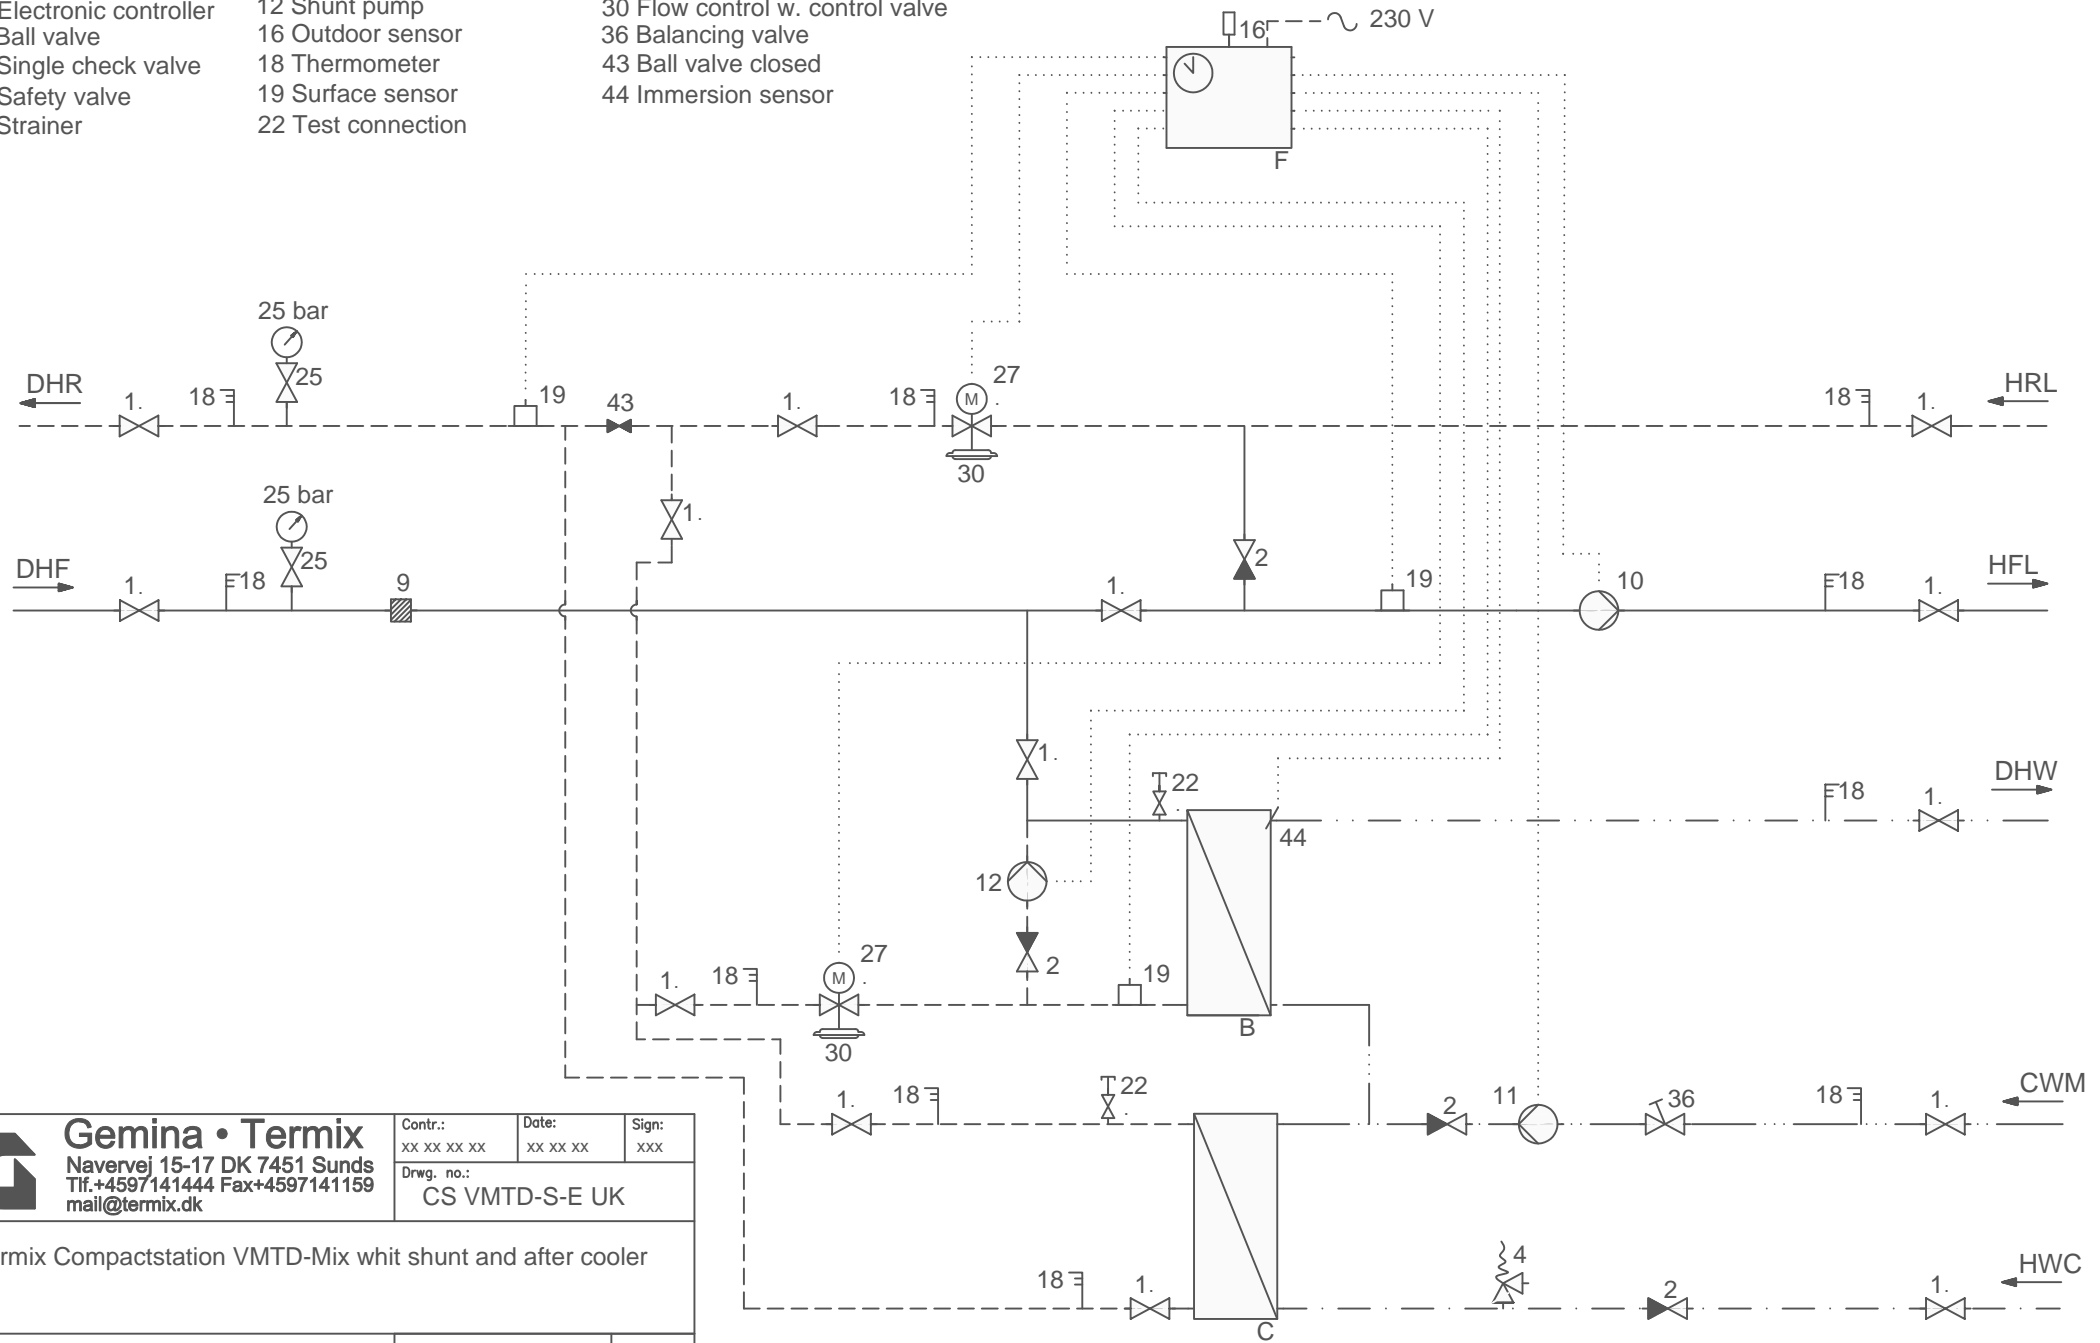

<p>Gemina • Termix Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk</p>	Contr.: xx xx xx xx	Date: xx xx xx	Sign: xxx
	Drwg. no.: CS VMTD-S-E UK		
Title: Termix Compactstation VMTD-Mix whit shunt and after cooler			
Diagram			
District Heating substation	Rev:	Date:	Sign.: