


- A Heat exchanger
- B Water heater
- F Electronic control
- 1 Ball valve
- 2 Single check valve
- 4 Safety valve
- 9 Strainer
- 10 Circulator pump
- 11 Domestic hot water pump
- 16 Outdoor sensor
- 18 Thermometer
- 19 Surface sensor
- 20 Filling/emptying valve
- 24 Delivered loose with unit
- 25 Manometer with ball valve
- 26 Manometer
- 27 Actuator
- 30 Flow control w. control valve
- 48 Air escape, manual

Obs:
 Gemina Termix recommends the mounting of balancing valves on the main central heating pipes and on the central heating return pipe directly in front of the district heating unit.

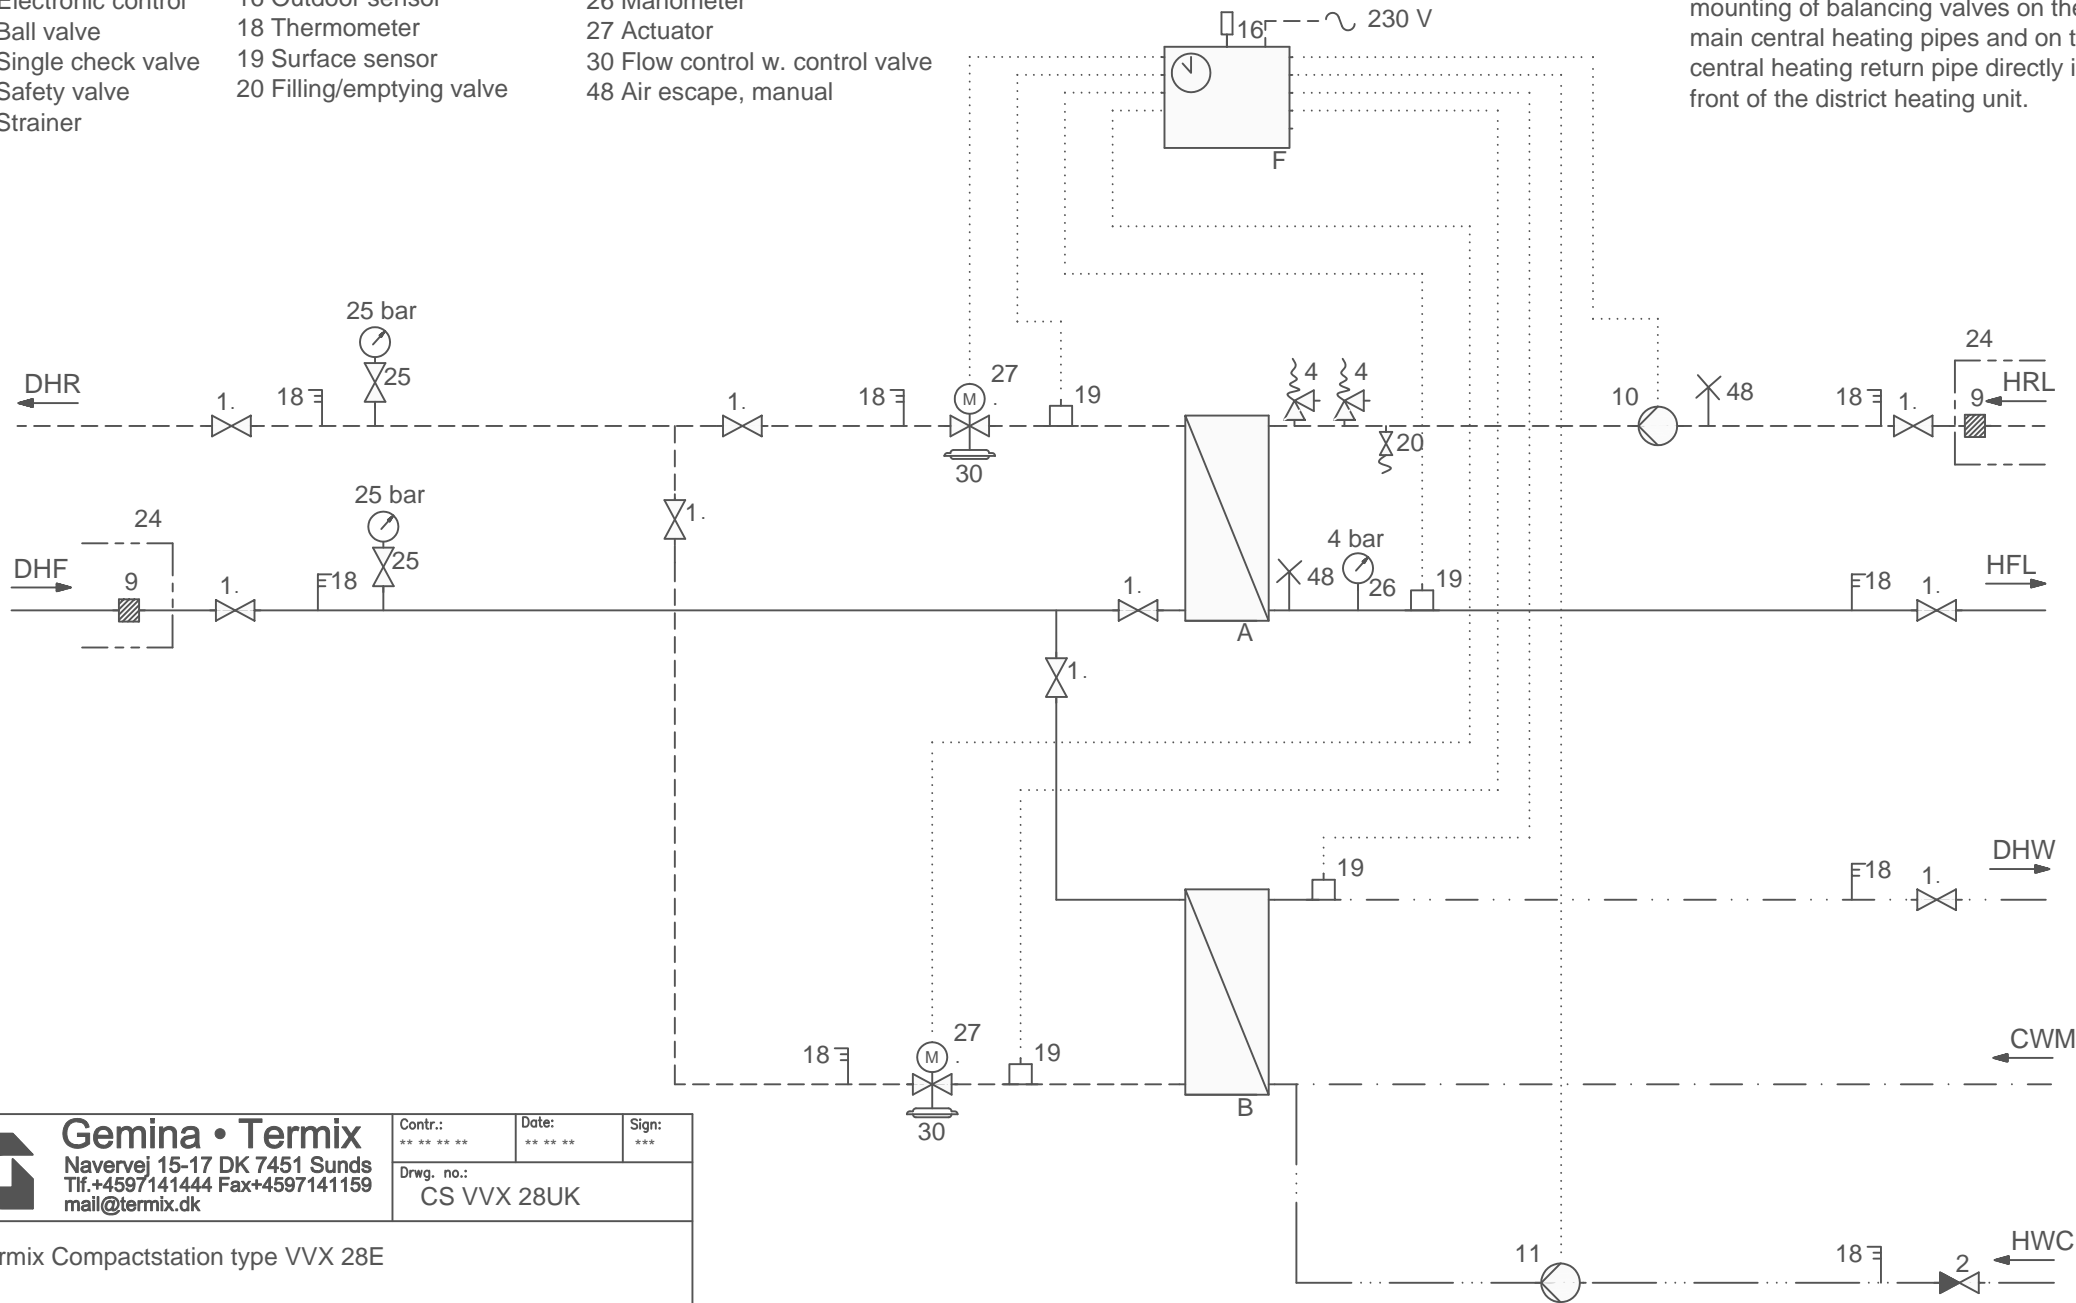

Gemina • Termix
 Navervej 15-17 DK 7451 Sunds
 Tlf.+4597141444 Fax+4597141159
 mail@termix.dk

Contr.: *****	Date: *****	Sign: ***
Drwg. no.: CS VVX 28UK		

Title: Termix Compactstation type VVX 28E		
Diagram		
District Heating Unit		
Rev:	Date:	Sign.: