


- A Heat exchanger
- D Hot water tank
- F Electronic control
- I Connection expansion tank
- 1 Ball valve
- 2 Single check valve
- 4 Safety valve
- 9 Strainer
- 10 Circulator pump
- 11 Domestic hot water pump
- 16 Outdoor sensor
- 18 Thermometer
- 19 Surface sensor
- 20 Filling/emptying valve
- 21 To be ordered separately
- 22 Test connection
- 23 Ball valve
- 24 Delivered loose with unit
- 25 Manometer with ball valve
- 26 Manometer
- 27 Actuator
- 29 2-way motorized valve
- 31 Differential pressure controller
- 39 Connection closed
- 44 Immersion sensor

Obs:
 Gemina Termix recommends the mounting of balancing valves on the main central heating pipes and on the central heating return pipe directly in front of the district heating unit.

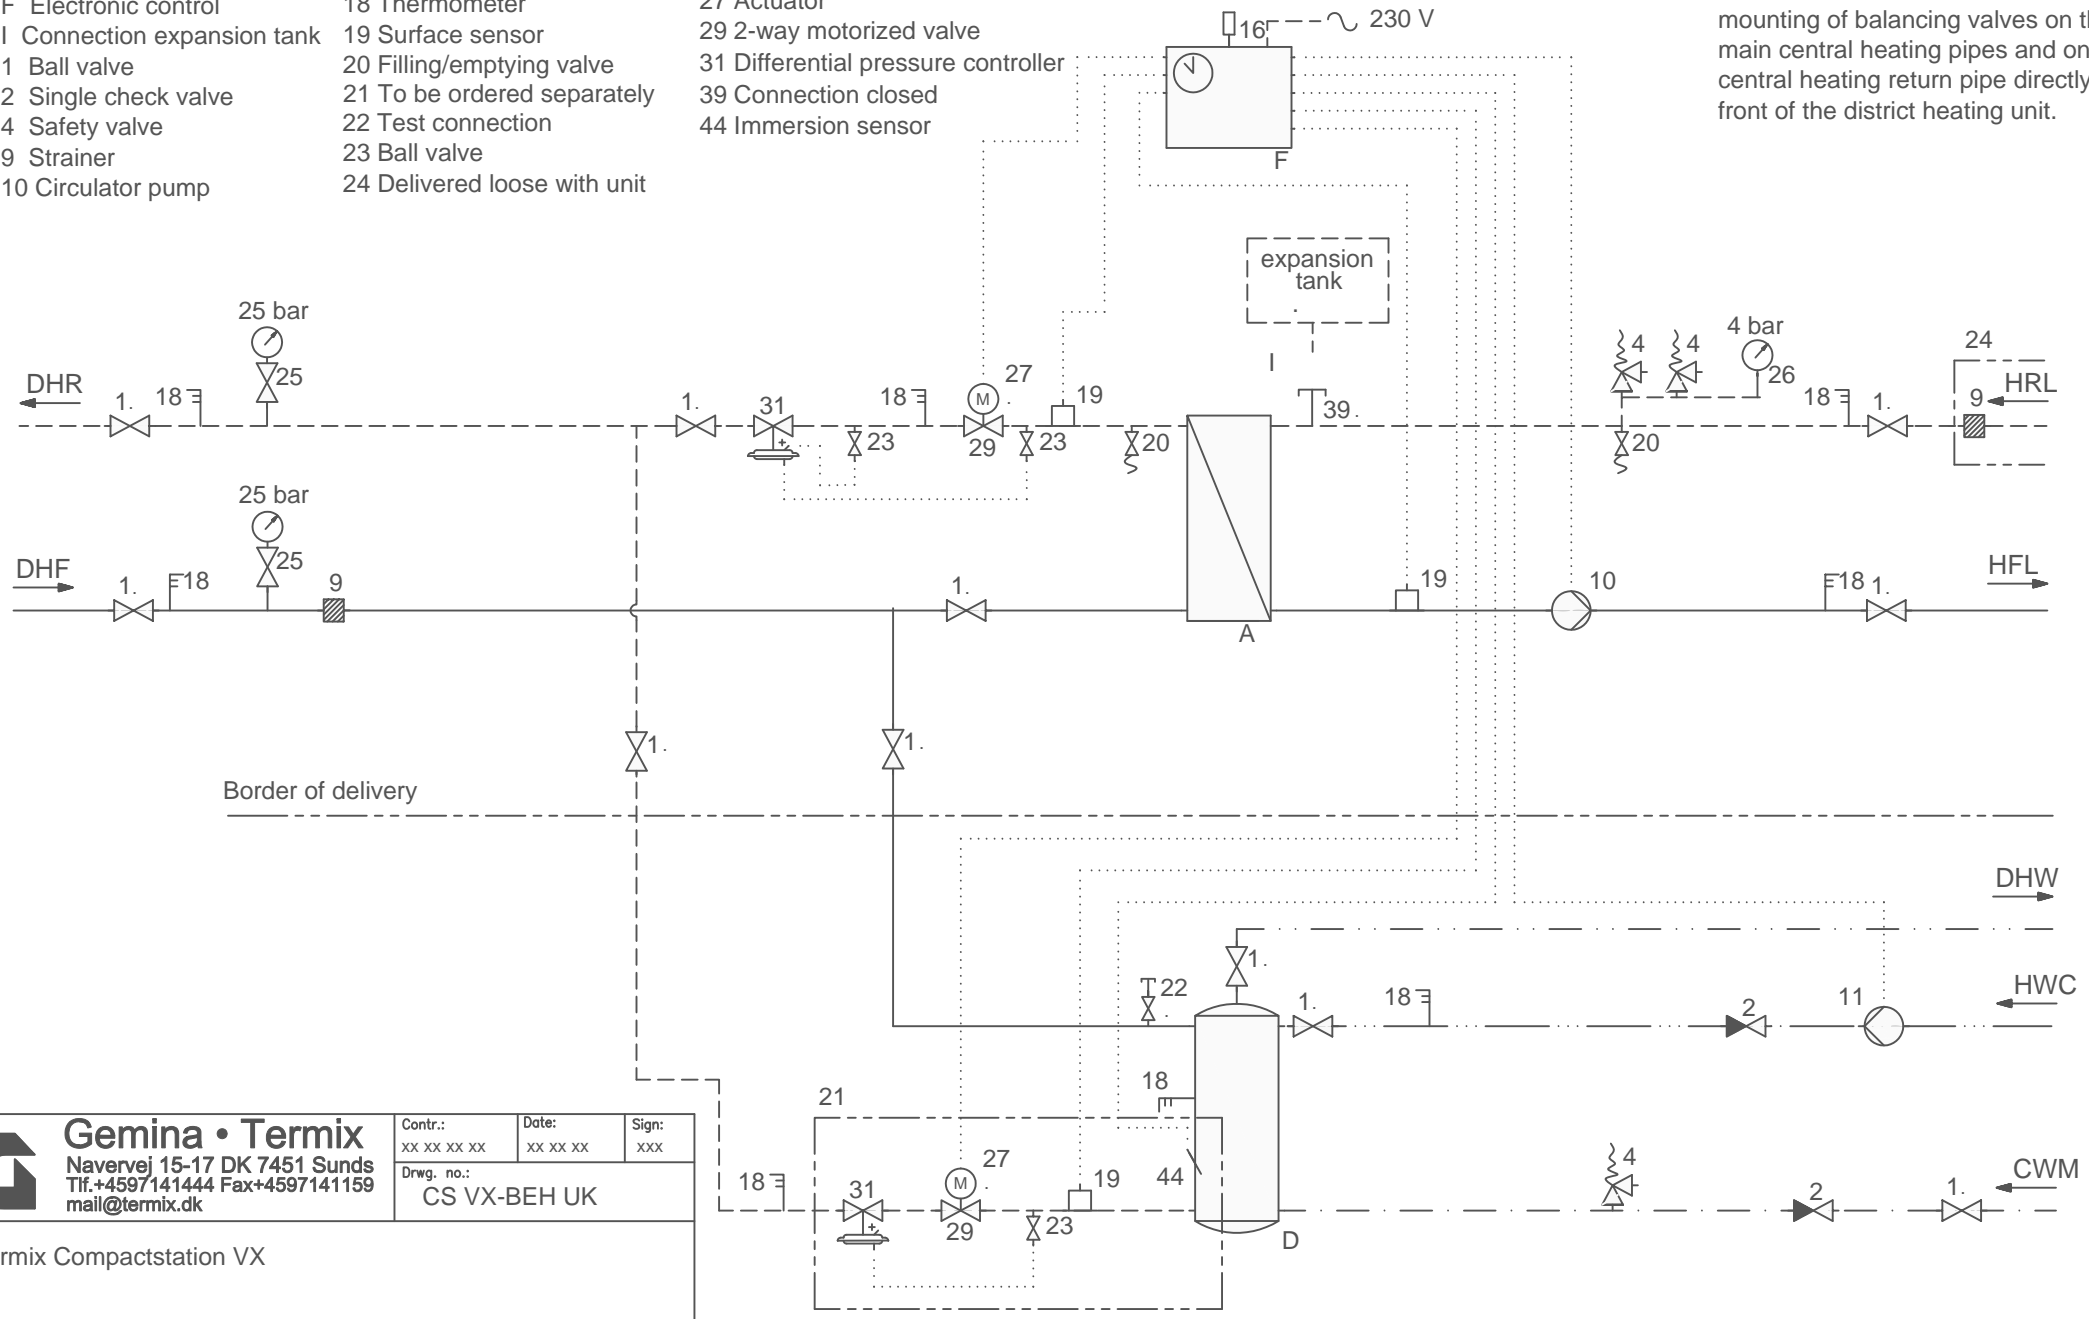

	Gemina • Termix Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk		
	Contr.: xx xx xx xx	Date: xx xx xx	Sign: xxx
Drwg. no.: CS VX-BEH UK			
Title: Termix Compactstation VX			
Diagram			
District Heating substation			
Rev:	Date:	Sign.:	