



- A Heat exchanger
- B Water heater
- F Electronic controller
- 1 Ball valve
- 2 Single check valve
- 4 Safety valve
- 7 Thermostatic valve
- 9 Strainer
- 10 Circulator pump
- 11 Domestic hot water pump
- 16 Outdoor sensor
- 18 Thermometer
- 19 Surface sensor
- 20 Filling/drain valve
- 23 Ball valve
- 24 Delivered loose with unit
- 26 Manometer
- 27 Actuator
- 29 2-way motorized valve
- 31 Differential pressure controller
- 48 Air escape, manual

Obs:  
 Gemina Termix recommends the mounting of balancing valves on the main central heating pipes and on the central heating return pipe directly in front of the district heating unit.

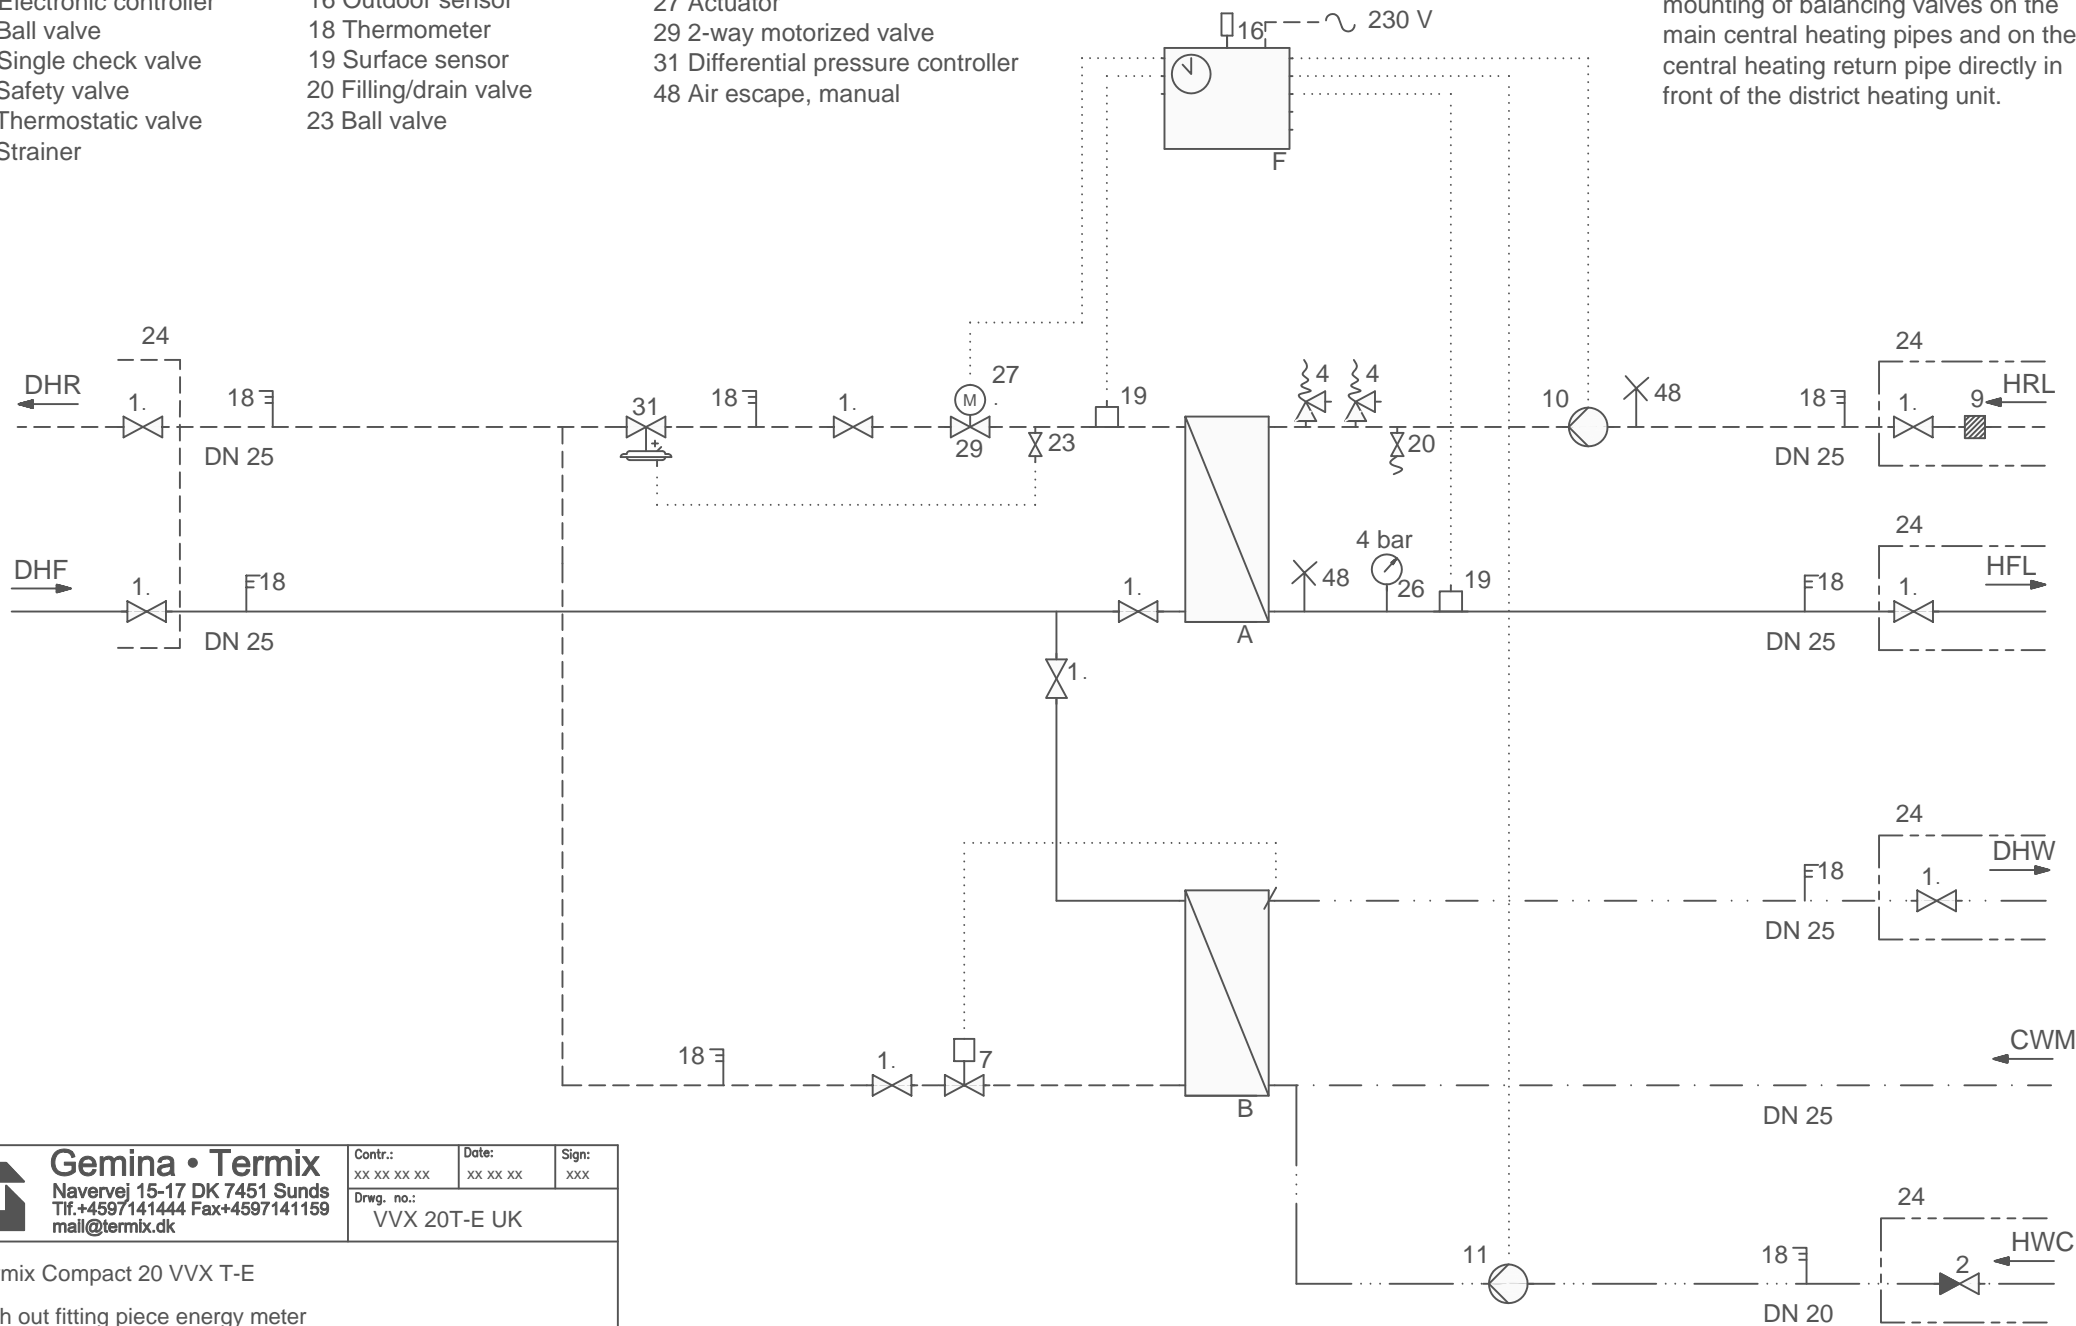

 <b>Gemina • Termix</b> Navervej 15-17 DK 7451 Sunds Tlf.+4597141444 Fax+4597141159 mail@termix.dk	Contr.:	Date:	Sign:
	xx xx xx xx	xx xx xx	xxx
Drwg. no.: <b>VVX 20T-E UK</b>			
Title: <b>Termix Compact 20 VVX T-E</b> With out fitting piece energy meter			
Diagram			
District Heating station	Rev:	Date:	Sign.: